

BRIEF COMMUNICATIONS

Maintenance of Optimal Fluoride Levels in Public Water Systems

Andrew R. Pelletier, MD, MPH

Abstract

Objective: This study examines the quality of water fluoridation in public water supplies. **Methods:** An assessment of daily fluoride levels among all communities that fluoridate their public water supplies in New Hampshire was conducted from January 1, 2000, through June 30, 2002. Results were compared against recommendations from the Centers for Disease Control and Prevention. **Results:** The fluoride concentration was less than the recommended minimum value on 42.0 percent of days, within the accepted control range on 49.8 percent of days, and above the recommended maximum value on 1.0 percent of days. On 7.1 percent of days, a fluoride concentration was not determined. Only 2 (18.2%) of 11 public water supplies maintained the fluoride concentration in the optimal range ≥ 80 percent of the days. **Conclusions:** For public water supplies in New Hampshire that fluoridate, suboptimal levels are the most common problem. Water systems need to better maintain recommended fluoride levels if communities are to realize the full benefits of fluoridation. [*J Public Health Dent* 2004;64(3):237-39]

Key Words: fluoridation, water, oral health, optimal levels, quality control.

The fluoridation of community water supplies is considered one of 10 great public health accomplishments of the 20th century (1). At the recommended optimal levels, fluoride is effective in preventing tooth decay (2). However, below the recommended levels there is less benefit in preventing caries and above the recommended levels, fluorosis can occur (2). This report presents the results of an assessment of how well optimal fluoride levels are maintained among the communities in New Hampshire that adjust the fluoride concentration of their public water supplies.

Methods

Data on daily fluoride concentrations during January 1, 2000–June 30, 2002, were obtained from the New Hampshire Department of Environmental Services. Communities that fluoridate their public water supply submit these results to the department on a monthly basis. Fluoride concen-

trations were determined either directly by laboratory analysis or indirectly by dividing the amount of fluoride used by the volume of water pro-

duced daily. Optimal fluoride levels and control ranges (i.e., minimum and maximum acceptable levels) for each community were based on the 30-year (1971–2000) annual average maximum daily air temperatures for each community and Centers for Disease Control and Prevention (CDC) recommendations (3). Optimal fluoride levels vary with air temperature based on studies showing that persons living in warmer climates drink more water than persons in cooler climates. For two communities temperature data were unavailable, so data from a neighboring town were used. Data were entered and analyzed using Epi Info 2002 (CDC, Atlanta, GA).

Ten communities in New Hampshire fluoridate their public water supply. One community has two water systems, both fluoridated, that serve the town and a local university. The median population of these 10 com-

FIGURE 1
Daily Fluoride Concentration, Community E, January 2001
(Control Range=1.0–1.6 ppm)

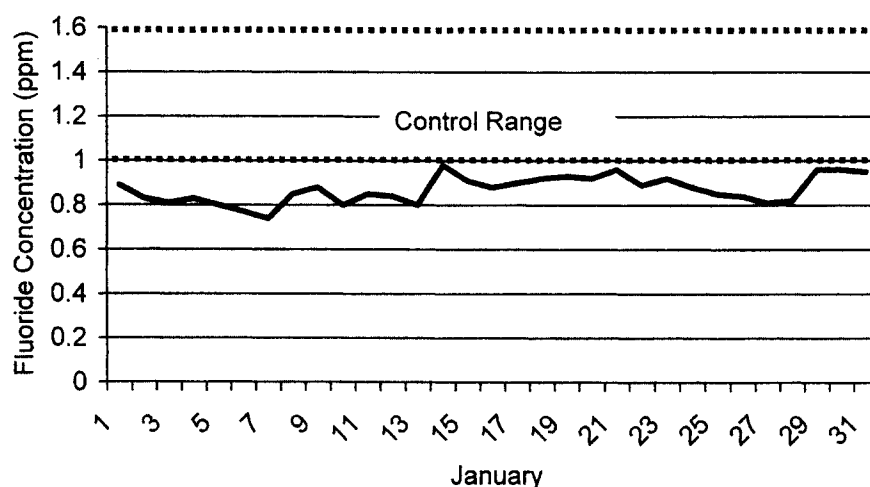


TABLE 1
Annual Average Maximum Daily Temperatures, Recommended Fluoride Concentration, Days without Determining Fluoride Concentration, and Days with Fluoride Concentration Below, In, or Above Control Range, by Community—New Hampshire, January 1, 2000–June 30, 2002

| Community | 30 yr* Annual Ave. Max. Daily Temps (°F) | Recommend. Fluoride Concentration in ppm (Control Range) | Days without Fluoride Deter- mination (%) | Days with Fluoride Concentration (%) | | |
|------------|---|---|--|--------------------------------------|------------------|---------------------|
| | | | | Below Control Range | In Control Range | Above Control Range |
| A | 57.7 | 1.1 (1.0–1.6) | 0 (0) | 317 (34.8) | 595 (65.2) | 0 (0) |
| B | 58.9¶ | 1.0 (0.9–1.5) | 24 (2.6) | 49 (5.4) | 839 (92.0) | 0 (0) |
| C (town)† | 58.9 | 1.0 (0.9–1.5) | 5 (0.6) | 443 (49.8) | 431 (48.5) | 10 (1.1) |
| C (univ.)† | 58.9 | 1.0 (0.9–1.5) | 0 (0.0) | 186 (23.6) | 588 (74.7) | 13 (1.7) |
| D | 57.1 | 1.1 (1.0–1.6) | 234 (25.7) | 535 (58.7) | 141 (15.5) | 2 (0.2) |
| E | 56.3 | 1.1 (1.0–1.6) | 0 (0) | 884 (96.9) | 28 (3.1) | 0 (0) |
| F | 52.6 | 1.2 (1.1–1.7) | 359 (39.4) | 147 (16.1) | 375 (41.1) | 31 (3.4) |
| G | 55.8 | 1.1 (1.0–1.6) | 1 (0.1) | 556 (61.0) | 354 (38.8) | 1 (0.1) |
| H‡ | 58.0 | 1.1 (1.0–1.6) | 0 (0) | 412 (73.7) | 147 (26.3) | 0 (0) |
| I | 58.6 | 1.0 (0.9–1.5) | 56 (6.1) | 403 (44.2) | 412 (45.2) | 41 (4.5) |
| J | 58.9¶ | 1.0 (0.9–1.5) | 0 (0) | 69 (7.6) | 842 (92.3) | 1 (0.1) |
| Total | — | — | 679 (7.1) | 4,001 (42.0) | 4,752 (49.8) | 99 (1.0) |

*1971–2000.

†Analysis restricted to days in which utility pumped water.

‡Fluoridation started on December 19, 2000.

¶Based on temperature data from a neighboring community.


munities was 14,800 (range: 2,160–128,000). These communities account for approximately 39 percent of the state population served by a public water system.

Results

The percentage of days in the study period during which a community's concentration of fluoride was not determined ranged from 0 to 39.4 percent (mean=7.1%) (Table 1). The percentage of days during which a community's fluoride concentrations was known to be in the control range varied from 3.1 percent to 92.3 percent (mean=49.8%). Fluoride concentrations were more often below the control range (42.0% of days) than above the control range (1.0% of days). Only 2 (18.2%) of the 11 public water supplies maintained the fluoride concentration in the optimal range ≥ 80 percent of the days.

Several different patterns in fluoride concentrations were noted among the 10 communities. In Community E, fluoride concentrations varied over a small range (0.7–1.0 ppm), but were consistently below the control range of 1.0–1.6 ppm (Figure 1). In Community J, concentrations again varied over a

FIGURE 2
Daily Fluoride Concentration, Community J, January 2001
(Control Range=0.9–1.5 ppm)

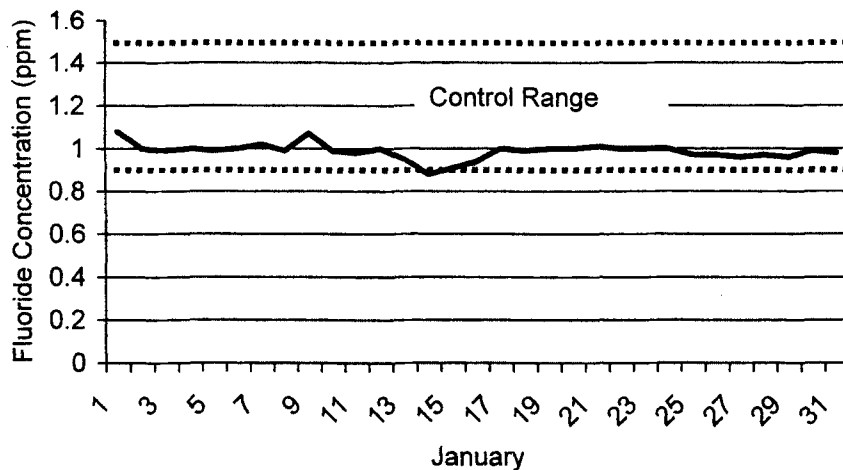


relatively small range (0.9–1.1 ppm), but were almost always within the control range of 0.9–1.5 ppm (Figure 2). In Community C (town), fluoride concentrations varied substantially (0.3–1.6 ppm) and fell within the control range of 0.9–1.5 ppm approximately two-thirds of the time (Figure 3).

Discussion

Although fluoridation of drinking water is recognized as an effective method of preventing dental caries, fluoride concentrations can vary markedly among communities that fluoridate (4,5). Fluoride concentrations below the recommended minimum level are the most common problem (4,5). Factors associated with

FIGURE 3
Daily Fluoride Concentration, Community C (Town), January 2001
(Control Range=0.9–1.5 ppm)

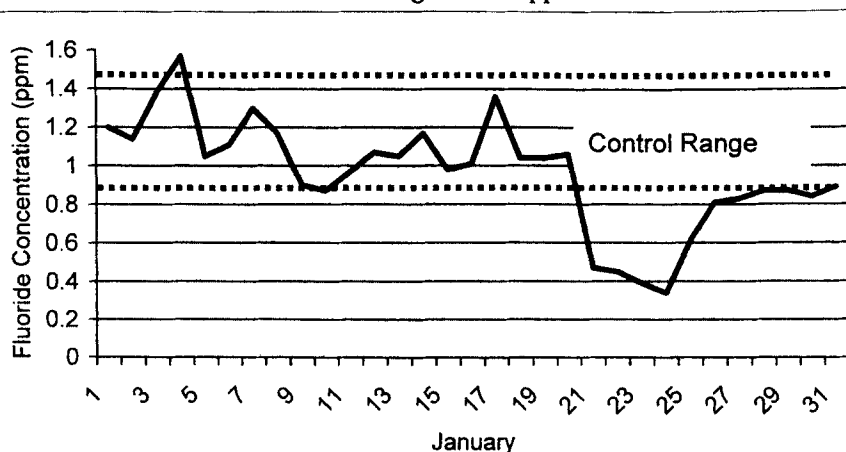

maintenance of optimal fluoride levels include operator training, operator turnover, source of water, and population size (6,7). Efforts to optimize fluoride levels have included a variety of approaches, including legal requirements, computerized databases that track fluoride levels, and compliance indices (8). CDC has made recommendations to state fluoridation programs concerning engineering and administrative practices (3) and has developed the Water Fluoridation Reporting System to help states and tribal governments monitor fluoride levels (9).

Although effective water fluoridation can prevent dental decay, caries remains a common problem in New Hampshire. In 2001, a total of 52 percent of students in third grade in public schools had a history of dental caries (10). Compared with other states, in 2000 New Hampshire had the eighth lowest percentage of its population receiving optimally fluoridated water through public water systems (9). One of New Hampshire's health objectives for 2010 is to increase this proportion from 43 percent to 65 percent. In New Hampshire, the level of fluoridation is both decided and managed at the local level; no state statutes or regulations address the maintenance of optimal fluoride levels.

The findings in this report are subject to at least two limitations. First, water plant operators might not have known about the fluoride recommen-

dations made by CDC. Results of a survey in 2001 indicated that many operators established optimal values and control ranges for their communities below the recommended values (New Hampshire Department of Health and Human Services, unpublished data, 2001). Second, methods to determine fluoride concentrations were not standardized among communities, and the state did not request communities to report which method they used. Indirect methods for calculating fluoride concentrations might be unreliable. None of the communities that adjust fluoride levels in New Hampshire regularly submitted split samples for testing to an outside laboratory to verify their results.

To improve water fluoridation, communities that adjust their fluoride concentrations should determine the fluoride concentration of their water on a daily basis using a laboratory-based method, submit split specimens for fluoride testing to a certified laboratory on a monthly basis, and comply with the optimal fluoride levels and control ranges recommended by CDC (3). Based on the results of this study, the New Hampshire Department of Health and Human Services and Department of Environmental Services plan to provide annual training on fluoridation to water plant operators, monitor fluoride levels through the Water Fluoridation Reporting System (9), and encourage

communities to adopt CDC recommendations for fluoridation programs (3).

Acknowledgments

This report is based on data contributed by water plant operators in Concord, Dover, Durham, Hanover, Laconia, Lancaster, Lebanon, Manchester, Portsmouth, and Rochester. Staff of the New Hampshire Department of Health and Human Services assisted with data entry. S. Knight, MSPH, New Hampshire Department of Health and Human Services, assisted with data analysis. N. Martin, MS, New Hampshire Department of Health and Human Services; B. Lucey, New Hampshire Department of Environmental Services; and D. Malvitz, DrPH, and E. Beltran, DMD, Centers for Disease Control and Prevention, reviewed the manuscript and provided comments.

References

- Centers for Disease Control and Prevention. Achievements in public health, 1900-1999: fluoridation of drinking water to prevent dental caries. *MMWR Morbidity and Mortality Weekly Report* 1999;48:933-40.
- Centers for Disease Control and Prevention. Recommendations for using fluoride to prevent and control dental caries in the United States. *MMWR Morbidity and Mortality Weekly Report* 2001;50(no RR-14):1-42.
- Centers for Disease Control and Prevention. Engineering and administrative recommendations for fluoridation, 1995. *MMWR Morbidity and Mortality Weekly Report* 1995;44(no RR-13):1-40.
- Long JG, Stowe H. Monitoring fluoride in Vermont's drinking water. *J Public Health Dent* 1973;33:13-21.
- Buzalaf MA, Granjeiro JM, Damante CA, Ornelas F. Fluctuations in public water fluoride levels in Bauri, Brazil. *J Public Health Dent* 2002;62:173-6.
- Kuthy RA, Naleway C, Durkee J. Factors associated with maintenance of proper water fluoride levels. *J Am Dent Assoc* 1985;110:511-13.
- Lalumandier JA, Hernandez LC, Locci AB, Reeves TG. US drinking water: fluoridation knowledge level of water plant operators. *J Public Health Dent* 2001;61:92-8.
- Kuthy RA, Wulf CA, Corbin SB. Use of a compliance index for community fluoridation. *Public Health Rep* 1987;102:415-20.
- Centers for Disease Control and Prevention. Population receiving optimally fluoridated public drinking water—United States, 2000. *MMWR Morbidity and Mortality Weekly Report* 2002;51:144-7.
- Centers for Disease Control and Prevention. Oral health survey of third grade students—New Hampshire, 2001. *MMWR Morbidity and Mortality Weekly Report* 2002;51:259-60.